



Guideline No.M-12(202607)

M-12

Governor

Issued date: July 01, 2026

© China Classification Society

Foreword

China Classification Society (hereinafter referred to as CCS) Product Inspection and Testing Guideline (hereinafter referred to as this Guideline) contains the technical requirements, inspection and testing criteria related to classification and statutory survey of marine products to be applied for CCS approval/inspection.

This Guideline frees the users to adopt other test methods and requirements which are equivalent to or are stricter than this Guideline.

This Guideline is published and updated by CCS, and is released at <http://www.ccs.org.cn>. Your comments or suggestions are welcomed and may be sent to our email addressed service@ccs.org.cn.

Historical versions and release date: M-12(201510) October 20, 2015

Main changes :

This version has been revised from the original guide as follows:

- a) Revised definitions of speed control system and steady-state speed regulation rate;
- b) Removed definitions related to transient process of speed regulation, rated power, rated speed, rated operating condition, maximum instantaneous speed, no-load speed, minimum instantaneous speed, and speed under partial load;
- c) Revised test classification, measurement of speed fluctuation rate, and method for sudden load application test;
- d) Removed unit/batch inspections ~~single item/single batch inspection.~~

CONTENTS

1 Application.....4

2 Basis for approval and inspection.....4

3 Terms and definitions.....4

4 Plans and documents.....8

5 Materials and components8

6 Technical requirements8

7 Type test.....12

8 Unit/batch inspection18

|

Governor

1 Application

This Guideline applies to the approval and inspection of hydraulic, electronic and electro-hydraulic governors for marine diesel engines and may be provided as a reference for other types of governors such as the injection pump assembly equipped with a mechanical governor and electronic injection device with a speed governing function.

2 Basis for approval and inspection

2.1 CCS Rules for Classification of Sea-Going Steel Ships

2.2 CCS Guideline on Type Approval Test of Electric and Electronic Products

3 Terms and definitions

3.1 For definitions of product inspection, design approval, type approval, prototype test, sample, unit/batch inspection and final inspection, refer to Article 3.1.2, Chapter 3, Part One of *Sea-going Rules*.

3.2 For the purpose of this Guideline, the following definitions apply:

(1) Speed governing system: A device that can automatically adjust the fuel supply according to the load changes to maintain the stable speed of the diesel engine. The speed regulation system mainly consists of sensors, speed regulation controllers, speed regulation actuators and regulating mechanisms, etc.

~~(2) Transitional process of speed adjustment: a process during which the speed varies with time due to load changes (as shown in Fig. 3.2(2)).~~

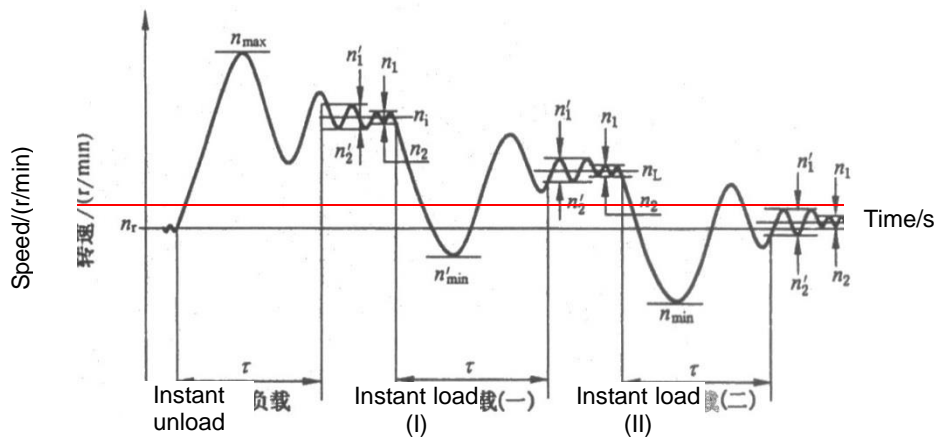


Fig. 3.2(2) Speed governing

~~(3) Rated power P_{er} : also called rated load, a power indicated on the nameplate in accordance with the purpose and use characteristic of the diesel engine.~~

~~(4) Rated speed n_r : a corresponding speed when the diesel engine outputs the rated power.~~

~~(5) Rated working condition: a working condition of the diesel engine at rated power and speed.~~

- ~~(6) Maximum transient speed n_{max} : the maximum value to which the speed increases after instant unloading of rated load when the diesel engine operates under the rated working condition.~~
- ~~(7) No load speed n_r : a steady speed after unloading of rated load when the diesel engine operates under the rated working condition.~~
- ~~(8) Minimum transient speed n_{min} : the minimum value to which the speed decreases after instant loading of rated load when the diesel engine stably operates under the no load condition.~~
- ~~(9) Part load speed n_L : a steady speed when the diesel engine operates under the part load condition.~~
- (102) Speed stability bandwidth v : the ratio of the difference between the maximum speed n_1 and the minimum speed n_2 measured within a certain time interval (not less than 1 min) to twice the rated speed n_r when the diesel engine operates under the invariable load working condition, which is represented in percentage and calculated by Eq. (1).

$$v = \frac{n_1 - n_2}{2n_r} \times 100\% \dots\dots\dots (1)$$

Where:

n_1 — measured maximum speed, in rotation per minute (r/min)

n_2 — measured minimum speed, in rotation per minute (r/min)

n_r — rated speed, in rotation per minute (r/min)

- (113) Steady state speed regulation δ_{st} : After the diesel engine speed control system is set at the rated operating condition, when the load changes from the rated load to no load or from no load to the rated load (either in one step or in segments), the percentage of the difference between the stable no-load speed and the rated speed to the rated speed is calculated according to formulas (2) and (3).~~the ratio of the difference between steady no load speed and full load speed to the rated speed when the load varies from rated load to no load or from no load to rated load, which is represented in percentage and calculated by Eqs. (2) and (3).~~

- ① Unloading of rated load under the rated working condition:

$$\delta_{st} = \frac{n_i - n_r}{n_r} \times 100\% \dots\dots\dots (2)$$

② Loading of rated load under the no-load condition (either in one step or in segments):

$$\delta_{st} = \frac{n_r' - n_i}{n_r} \times 100\% \dots\dots\dots (3)$$

Where:

n_i — steady no-load speed, in rotation per minute (r/min)

n_r — rated speed, in rotation per minute (r/min)

n_r' — steady speed after loading of rated load, in rotation per minute (r/min)

(124) Transient speed regulation δ_d : After the diesel engine has been set to a steady-state speed regulation rate, the maximum or minimum speed difference between the speed after a sudden unloading or loading (either in one go or in stages) of the specified load and the stable speed before the load change, as a percentage of the rated speed, is calculated according to formulas (4) to (6). the ratio of the difference between the maximum or minimum speed after (one time or phase by phase) instant unloading or loading of rated or part load and the steady speed before load changes to the rated speed, which is represented in percentage and calculated by Eqs. (4)–(6).

① Instant unloading of rated load under the rated working condition:

$$\delta_d = \frac{n_{max} - n_r}{n_r} \times 100\% \dots\dots\dots (4)$$

② Instant loading of part load under the no-load condition:

$$\delta_d = \frac{n_{min}' - n_i}{n_r} \times 100\% \dots\dots\dots (5)$$

③ Instant loading of rated load under the part-load condition:

$$\delta_d = \frac{n_{min} - n_L}{n_r} \times 100\% \dots\dots\dots (6)$$

(135) Steady state: After the load changes, the variation in speed eventually falls within the specified speed fluctuation rate ν range. The speed control system remains within this range at all times. a state of the speed governing system when the variable speed finally enters into and stays within the specified range of speed stability bandwidth ν after load changes. Otherwise, the speed governing system is in the unsteady state.

(146) Steady speed: the average speed (r/min) measured within a certain time interval (not less than 1 min) when the speed fluctuates within the specified range of speed stability bandwidth ν in case that the diesel engine is under the invariable load condition.

(157) Speed recovery time τ : the time from instant load and speed changes to speed entry into and stay within the range of permissible speed stability bandwidth α which is calculated by Eq. (7).

$$\alpha = \frac{n'_1 - n'_2}{2n_r} \times 100\% \dots \dots \dots (7)$$

Where:

n'_1 — maximum speed corresponding to permissible speed stability bandwidth α , in rotation per minute (r/min)

n'_2 — minimum speed corresponding to permissible speed stability bandwidth α , in rotation per minute (r/min)

(168) Speed governing characteristic curve: Curve 3 obtained by connecting the arithmetic mean values of two speeds corresponding to a certain power on Curve 1 obtained by fixing the governor control handle (or knob) and slowly reducing the load and on Curve 2 obtained by slowly increasing the load afterwards under the rated working condition at different power levels. (3.2(168)).

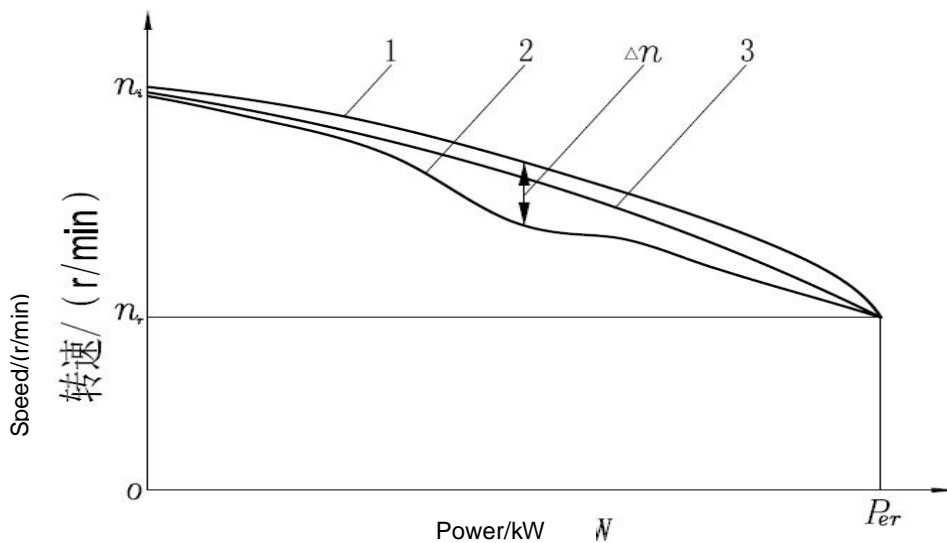


Fig. 3.2(168) Speed governing characteristic curve

(179) Non-sensitivity of speed governing system ε : the ratio of the maximum speed difference Δn absolute value between curve 1 and curve 2 (as shown in Fig. 3.2(168)) to the rated speed n_r under a certain power condition, which is represented in percentage and calculated by Eq. (8).

$$\varepsilon = \left| \frac{\Delta n}{n_r} \right| \times 100\% \dots \dots \dots (8)$$

(180) Non-linearity γ of speed governing characteristic curve: the absolute value of the ratio of the maximum speed deviation between the speed governing characteristic curve and the ideal straight line (5) (as shown in Fig. 3.2(180)) to the rated speed n_r , which is represented in percentage and calculated by Eq. (9).

$$\gamma = \left| \frac{n_3 \text{ (or } n_4) - \tilde{n}_i}{n_r} \right| \times 100\% \dots\dots\dots (9)$$

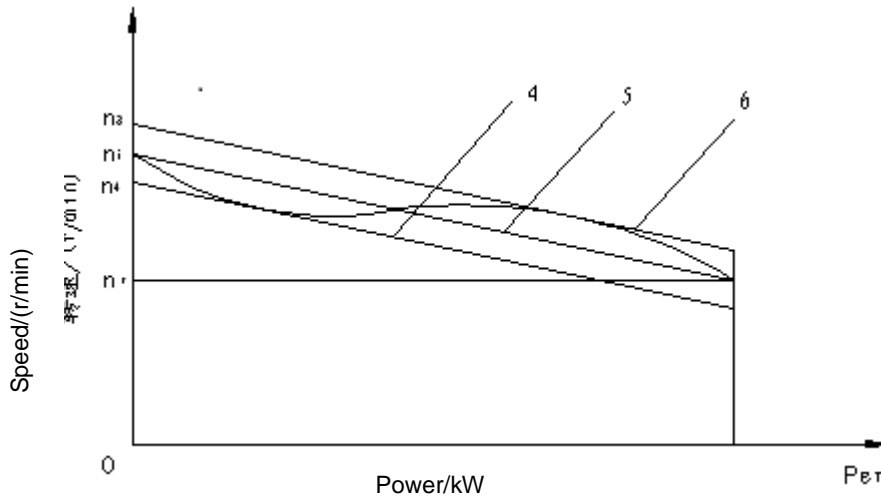


Fig. 3.2(180) Non-linearity of speed governing characteristic curve

The ideal straight line 5 is obtained by connecting two end points (0, n_i) and (P_{er} , n_r) of speed governing characteristic curve. Straight lines 4 and 6 (as shown in Fig. 3) parallel to the ideal straight line 5 and tangent to the speed governing characteristic curve are intersected with the axis n at n_4 and n_3 . The maximum deviation is the larger of the differences between n_3/n_4 and n_i .

(191) Difference of load sharing θ When diesel main engines or diesel generator sets operate in parallel, the difference between the load rate of a single unit and the total load rate is taken as the absolute value and expressed as a percentage. It is calculated according to formula (10).~~at parallel operation for main diesel engines or diesel generator sets is the absolute value of the difference between the load rate of a single set and the total load rate, which is represented in percentage and calculated by Eq. (10).~~

$$\theta = \left| \frac{P_i}{P_{ri}} - \frac{\sum P_i}{\sum P_{ri}} \right| \times 100\% \dots\dots\dots (10)$$

Where:

P_i — actual load of the i^{th} set, in kilowatt (kW);

P_{ri} — rated power of the i^{th} set, in kilowatt (kW);

$\sum P_i$ — actual total load at parallel operation for sets, in kilowatt (kW);

$\sum P_{ri}$ — total rated power at parallel operation for sets, in kilowatt (kW)

4 Plans and documents

4.1 The following plans and technical documents are to be submitted to CCS for approval at the time of approval application:

- (1) Main product performance specification table; (speed range, working oil pressure, output shaft torque and angle, operating voltage, other electrical parameters, etc.)
- (2) Assembly plan or (and) schematic diagram;
- (3) Plans of important parts and components;
- (4) Type test program.

4.2 The following plans and technical documents are to be submitted to CCS for information at the time of approval application:

- (1) Instructions on product use;
- (2) Samples of product nameplate, certificate of inspection, etc.

4.3 In addition to the above plans and documents, the following documents are to be submitted by the manufacturer:

- (1) Related factory profile (including factory history and current situation) and product production history descriptions which may be attached with the related report and certificate if the product has been subject to special verification or appraisal;
- (2) Quality control plan which is to be established for the product within the approved range and submitted to CCS for examination by the manufacturer and is to specify the quality assurance and control methods during product manufacturing in accordance with the technical requirements or standards of the product, include the approved inspection plan and particularly reflect the inspection and test requirements required in the CCS Rules.

5 Materials and components

5.1 The parts that may have a great influence on the performance and reliability of the governor such as spring, flyweight, various matching parts, etc. are to be considered as important.

5.2 The controller and actuator of the electronic governor are to be considered as important.

6 Technical requirements

6.1 The accuracy class and applicable scope of marine diesel engine speed regulation systems are listed in Table 6.1. Special requirements exceeding Class 1 accuracy shall be agreed upon by both suppliers and buyers. If any individual parameter exceeds Class 1 accuracy, the remaining parameters shall comply with Class 1 accuracy specifications.

Table 6.1 Precision Grades of Diesel Engine Speed Control Systems

<u>A</u> ccuracy class	<u>s</u> cope of application
<u>1</u>	<u>Power generation units requiring the highest precision in stable frequency and voltage output</u>
<u>2</u>	<u>Power generation units requiring high-precision stable frequency and voltage output</u>
<u>3</u>	<u>A diesel engine for electric propulsion or multi-unit single propeller systems requiring generator sets with general accuracy, stable frequency, and voltage for parallel operation</u>
<u>4</u>	<u>General direct-drive diesel engine and other applications of diesel engines</u>

6.2 When a diesel engine or diesel generator set experiences sudden load shedding or sudden load addition (single or staged), the instantaneous speed regulation rate δd , steady-state speed regulation rate δst , and speed stabilization time τ must not exceed the values specified in Table 6.2.

<u>a</u> ccuracy class	<u>v</u> ariation in load		
	<u>Sudden or gradual discharge: 100% → 0;</u> <u>Sudden or gradual addition: 0 → 100%</u>	<u>s</u> udden rupture <u>s</u> egmental abrupt onset	
	<u>δst/%</u>	<u>δd/%</u>	<u>τ/s</u>
<u>1</u>	<u>2</u>	<u>5</u>	<u>2</u>
<u>2</u>	<u>3</u>	<u>7</u>	<u>3</u>
<u>3</u>	<u>5</u>	<u>10</u>	<u>5</u>
<u>4</u>	<u>10</u>	<u>High-speed machine:</u> <u>12</u>	<u>=</u>
		<u>Medium-low speed machine:</u> <u>15</u>	<u>=</u>

For diesel generator sets operating in parallel, the governor must incorporate a mechanism capable of adjusting the steady-state regulation rate, with the values set to be essentially equal. These values are determined through testing by the original equipment manufacturer (OEM) of the generator sets.

Note: When measuring the speed stabilization time τ , a larger value of τ is adopted under segmented sudden acceleration conditions.

6.3 The rotational speed fluctuation rate v of the speed regulation system shall not exceed the values specified in Table 3.

Table 6.3 Speed Fluctuation Rate

<u>Diesel engine operating conditions</u>			<u>Accuracy class</u>			
			<u>1</u>	<u>2</u>	<u>3</u>	<u>4</u>
			<u>$v/\%$</u>			
<u>Diesel engine</u>	<u>RPM Ratio Between No-Load Operation Speed and Rated Speed</u>	<u>>50%</u>	<u>=</u>	<u>=</u>	<u>1.5</u>	<u>2.5</u>
	<u>The ratio of corresponding speed to rated speed when operating according to propulsion characteristics</u>	<u>≤50%</u>	<u>=</u>	<u>=</u>	<u>1.0</u>	<u>2.0</u>
		<u>>50%</u>			<u>0.7</u>	<u>1.5</u>
<u>Diesel generator sets operate at rated speed</u>		<u>Various loads</u>	<u>0.25</u>	<u>0.4</u>	<u>0.5</u>	<u>=</u>

6.4 The non-sensitivity ε of the speed regulation system shall not exceed the values specified in Table 6.4.

Table 6.4 Insensitivity of Speed Control System

	<u>1</u>	<u>2</u>	<u>3</u>	<u>4</u>
<u>$\varepsilon/\%$</u>	<u>0.25</u>	<u>0.35</u>	<u>0.50</u>	<u>=</u>

6.5 For diesel main engines and diesel generator sets operating in parallel, the curvature direction of their speed control system characteristic curves must be consistent, and the non-linearity (γ) of the speed control characteristic curves shall not exceed the limits specified in Table 6.5.

Table 6.5 Non-linearity of Speed Control System

<u>Accuracy class</u>	<u>1</u>	<u>2</u>	<u>3</u>	<u>4</u>
<u>$\gamma/\%$</u>	<u>$0.15\delta_{st}$</u>	<u>$0.15\delta_{st}$</u>	<u>$0.20\delta_{st}$ (Hydraulic Speed Control System)</u> <u>$0.30\delta_{st}$ (Mechanical speed control system)</u>	<u>—</u>
<u>Note: The δ_{st} in the table represents the actual steady-state modulation rate.</u>				

6.6 For diesel main engines and diesel generator sets operating in parallel, the load distribution difference θ shall not exceed 15%.

6.7 AC generator sets operating in parallel must be equipped with a remote speed control mechanism for synchronous operation and active load distribution/transfer control. The adjustment rate shall operate within the rated speed range of $\pm 0.2\%$ to 1.0% per second, with a speed adjustment range of no less than $\pm 10\%$ of the rated speed. The system shall include a manual-automatic switching device.

6.8 Diesel engines with an output power of no less than 220 kW shall be equipped with independent overspeed protection devices to prevent the maximum rotational speed of the diesel engine from exceeding 120% of the rated speed or the maximum rotational speed of the diesel generator set from exceeding 115% of the rated speed.

~~6.1 The hydraulic governor is to be equipped with a reliable emergency stop mechanism.~~

~~6.2 The speed, steady state speed regulation (dial type governor) and compensation mechanism of the governor may be adjusted outside it.~~

~~6.3 The compensating needle valve of the hydraulic governor is to have the features of easy adjustment and good sensitivity.~~

~~6.4 The electrical facilities of the electronic governor and all other governors are to at least work under the rated voltage of 90% or below.~~

~~6.5 The detailed general technical requirements for the electronic governor as a kind of electrical and electronic equipment are to be in accordance with the provisions of *Guideline on Type Approval Test of Electrical and Electronic Equipment of CCS*.~~

~~6.6 With regard to governors for generator sets providing stable frequency and voltage with a general precision, the speed stability bandwidth, transient speed regulation, steady state speed regulation, recovery time and non-sensitivity are not to exceed 0.5%, 10%, 5%, 5 s and 0.5%~~

respectively.

~~6.7 With regard to governors for common directly driven main engines and diesel engines for other purposes, the speed stability bandwidth, transient speed regulation and steady state speed regulation are not to exceed 1.5%, 15% and 10% respectively.~~

~~6.8 The governors are to meet the parallel operation requirement of the diesel engine. With regard to governors for electrically propelled or multi engine single propeller propelled diesel engines operating in parallel, the speed stability bandwidth, transient speed regulation, steady state speed regulation, recovery time and non sensitivity are not to exceed 0.7%, 10%, 5%, 5 s and 0.5% respectively. With regard to main diesel engines and diesel generator sets operating in parallel, the speed governing characteristic curve is to bend in the same direction, its non linearity γ is not to exceed $0.2\delta_{ss}$ (δ_{ss} — actual steady state speed regulation), and the difference of load sharing θ is not to exceed 15%. The governor regulating mechanism is to ensure a load adjustment which is less than 5% of rated power of the generator at normal frequency.~~

~~6.9 Where the electronic governor for the main engine constitutes a part of the remote control system, 1) if the governor is de-energized, the speed and thrust direction of the diesel engine are not to be changed greatly or instantly, otherwise, the provision of a standby power supply is to be explicitly required in the instructions; 2) the main engine is to implement local control when any part of the automatic or remote control system fails, for this purpose, it is to locally disconnect the remote control signal.~~

7 Type test

7.1 In case of one of the following conditions, the type test is to be carried out:

- (1) First approval;
- (2) New design or major improvement of governor;
- (3) Request by the Surveyor at the time of certificate renewal approval.

7.2 Principles for selection of typical sample:

- (1) Respective selection of samples of different types of governors, e.g. hydraulic and electronic governors;
- (2) Respective selection of samples of governors for common directly-driven main engines and generator sets;
- (3) Selection of one or two types of products as samples for governors with different operating capabilities in the same series.

7.3 Test equipment, apparatus and instrument

The priority is to be given to the type test of the governor together with the matched diesel engine.

With the consent of the Surveyor, the type test may be simulated on a special test bench or by matching the governor with other diesel engines. The test bench is to have the capability of measuring the transient speed stability bandwidth, e.g. oscilloscope, etc. The equipment, apparatus and instrument required for the test are to be qualified through calibration, and their precision grade and measurement range are to meet the test requirements.

7.4 Type test of the governor for the main diesel engine

7.4.1 Steady state characteristic test

When the diesel engine is operating under the rated condition and with the throttle fixed, gradually reduce the load slowly, so that the power of the diesel engine decreases from the rated value to zero; then slowly increase the load, so that the power of the diesel engine increases from zero to the rated value. Measure the stable speed and corresponding power before and after the load change. Record the measurement results and draw the speed regulation characteristic curve as shown in Figure 7.4.1; calculate the steady-state regulation rate and the non-linearity of the speed regulation characteristic curve and the sluggishness of the speed regulation system (parallel main engine).
~~When the diesel engine is under the rated working condition, fix the governor control handle (or knob) and slowly reduce the load to decrease the diesel engine power from the rated value to zero; then slowly increase the load to improve the diesel engine power from zero to the rated value. Measure the steady speeds and corresponding powers before and after load changes.~~

~~Record the measured results in Table A.1 and draw the curve as shown in Fig. 7.4.1; obtain the steady state speed regulation, non-linearity of speed governing characteristic curve and non-sensitivity of speed governing system (for paralleled main engine).~~

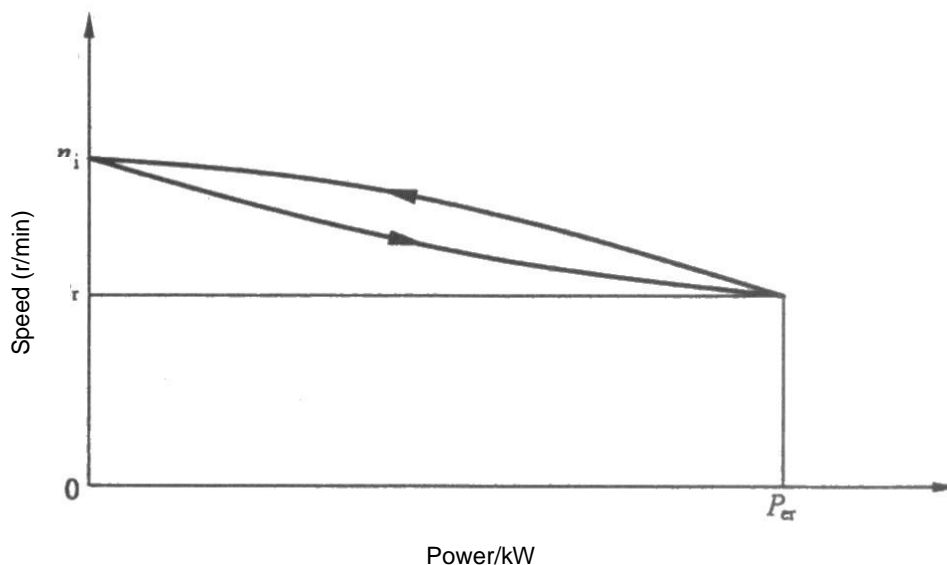


Fig. 7.4.1 Schematic plan diagram of speed governing characteristic curve

7.4.2 Speed stability bandwidth measurement and test

Measure the following items when the diesel engine is under the stable working condition:

- (1) Speed stability bandwidth at ~~speedloads~~ equal to 100%, ~~9475%~~, ~~850%~~, and ~~6325%~~ of rated value and at ~~no-load~~~~the minimum~~ steady speed according to the propulsion characteristic;
- (2) Speed stability bandwidth under the no-load condition and at speeds equal to 100%, 80% and 50% of rated value.

~~See Table A.2 for the record form.~~

7.4.3 Dynamic characteristic test

~~Instant unload test:~~ Conduct instant unloading of rated load and measure the followings items when the diesel engine is under the rated working condition:

- (1) Speed before instant unloading;
- (2) Power before instant unloading;
- (3) Maximum transient speed at the time of instant unloading;
- (4) Speed after instant unloading;
- (5) Speed recovery time.

Two methods for instant unloading:

- (1) ~~Load consumption system - Cut off the load power supply~~~~Generator device — disconnect the load power supply~~
- (2) Hydraulic dynamometer — A quick-closing valve (such as a butterfly valve or ball valve) should be installed. Close the inlet valve as soon as possible and sufficiently open the outlet valve.

7.4.4 Test of overspeed protection device

The diesel engine is equipped with an overspeed protection device. This test should be conducted. During the test, the rotational speed of the diesel engine should not exceed 120% of the rated value. It should meet the requirements in all three consecutive tests.

7.5 Type test of the governor for a single diesel generator set

7.5.1 Inspection and test of adjustable range of steady state speed regulation

Adjust the steady state speed regulation regulating mechanism of the governor to change and test the steady state speed regulation so as to check its adjustable range within which the set is to operate stably.

7.5.2 Steady state characteristic test

~~Speed governing characteristic test:~~ When the diesel engine is under the rated working condition, ~~fix at a given rotational speed~~~~fix the governor control handle (or knob)~~ and take two points within the range of steady state speed regulation for testing. Slowly reduce the load to decrease the electric power from the rated value to zero; then slowly increase the load to improve the electric power from zero to the rated value (slowly change the load in a single direction). Measure the steady speeds and corresponding powers before and after load changes.

Record the measured results ~~in Table A.4~~ and draw the curve as shown in Fig. 7.4.1; obtain the steady state speed regulation, non-linearity of speed governing characteristic curve and non-sensitivity of speed governing system.

7.5.3 Speed stability bandwidth measurement and test

Adjust the speed to the rated value and measure the speed stability bandwidth under the loads equal to 100%, 75%, 50% and 25% of rated electric power and under the no-load condition (which is allowed to be conducted together with the speed governing characteristic test).

~~See Table A.5 for the record form.~~

7.5.4 Dynamic characteristic test

~~Instant unload and load tests:~~ Mainly measure the following items for these tests:

- (1) Speed before instant unloading;
- (2) Electric power before instant unloading;
- (3) Maximum transient speed at the time of instant unloading;
- (4) Speed after instant unloading;
- (5) Electric power after instant loading;
- (6) Minimum transient speed at the time of instant loading;
- (7) Speed recovery time.

7.5.5 When the diesel generator set is under the rated working condition, conduct instant unloading of rated load and perform instant loading after recovery. Continuously repeat such operation for three times and take their average value as the test result.

~~See Table A.6 for the record form.~~

7.5.6 Methods for instant loading:

- (1) The supercharged diesel engine is to be loaded step by step in two phases: first 0→50% and then 50%→100% after recovery. The highly supercharged four-stroke diesel engine may be loaded in more than two phases (as per the methods in Fig. 7.5.6(1)).

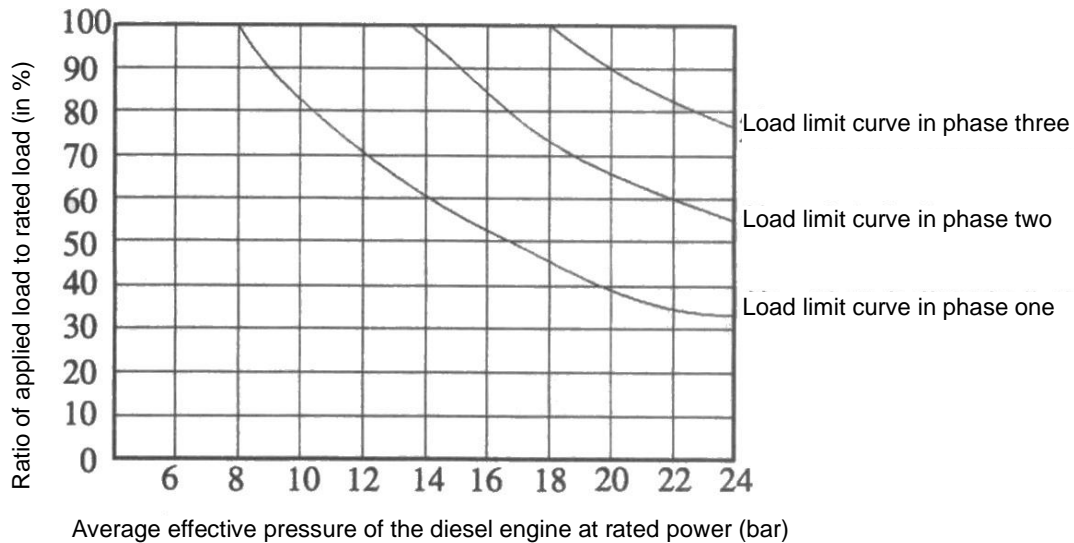


Fig. 7.5.6(1) Loading methods for the speed governing test of the highly supercharged four-stroke diesel engine

- (2) The first instant load on the emergency diesel generator set is not to be less than the specified total emergency load.

7.5.7 Inspection and test of the speed remote control mechanism

- (1) Sensitivity test: When the diesel generator set is in operation, press the speed remote control button or rotate the remote control knob and observe whether the accelerator and reducer operate normally and whether the diesel engine speed varies uniformly.
- (2) Speed regulation measurement and test: When the diesel generator set is in operation, measure the time required for each speed variation by 10% of rated value according to the reading on the tachometer ~~and see Table A.7 for the record form.~~

7.5.8 Test of overspeed protection device

The diesel engine is equipped with an overspeed protection device. The test should be conducted under no-load conditions. When the engine speed reaches 112% to 115% of the rated speed (not exceeding 115%), the overspeed protection device should act quickly and stop the engine. The speed at which the engine stops should not exceed 115% of the rated speed. This should be successful for three consecutive times.

7.6 Type test of governors for diesel generator sets operating in parallel

The type test of governors for diesel generator sets operating in parallel may be conducted only according to the items in 7.5. The parallel operation test may be performed by reference to the following items when it is necessary in the opinion of the Surveyor or user.

The automatic frequency and load adjuster is not to be used for this test.

7.6.1 Parallel operation inspection and test:

- (1) Adjust the steady state speed regulation of each set to be basically the same, load the set in trail operation to 75% ~ 100% of rated electric power and then adjust the speed of the paralleled set to put it into parallel operation.
- (2) Transfer the load of the operating set to the paralleled set and then to the original operating set, and observe the load operation stability.

7.6.2 Load sharing and its stability test at parallel operation for sets

- (1) Adjust the electric powers of two sets ready for parallel operation to 75% of rated power respectively. Keep the given speed invariable by using the power factor of 0.8 as a reference point, slowly change the total load in a single direction as per the procedure of 75%→100%→75% →50%→20%→50%→75%, measure the parameters of each set, record them ~~in Table A.8~~ and calculate the difference of load sharing at parallel operation for sets.
- (2) Continuously operate the set for 1 h under the total load equal to 90% of rated electric power, record the data once every 15 min and check the load sharing stability at parallel operation for sets. ~~See Table A.9 for the record form.~~

7.6.3 Dynamic stability test

After putting the set into parallel operation, instantly load 30% of the rated electric power of a single set under such an working condition that the total load is equal to ~~(25%~50%)~~ of rated electric power and check the dynamic stability at parallel operation for sets.

7.7 In addition to the above performance tests, the following basic tests are to be performed as per the relevant requirements of *Guideline on Type Approval Test of Electrical and Electronic Equipment* ~~(2006)~~ of CCS at the time of type test of the electrical parts for electronic and electro-hydraulic governors:

- (1) Insulation resistance measurement;
- (2) Power supply variation test;
- (3) Power supply failure test;

- (4) Inclination and swaying test;
- (5) Vibration test;
- (6) Dry heat test;
- (7) Low temperature test;
- (8) Electromagnetic compatibility test;
- (9) Cyclic damp heat test;
- (10) Steady damp heat test;
- (11) Voltage withstanding test;
- (12) Enclosure protection test.

7.8 In addition to the above speed governing performance tests, the following tests are to be performed where applicable:

- (1) Local and remote control test;
- (2) Emergency stop efficiency test;
- (3) Maximum power piston stroke or output shaft angle inspection;
- (4) Working oil pressure stability inspection;
- (5) Inspection of working oil pressure at the minimum operating speed;
- (6) Inspection of adjustable range of steady state speed regulation;
- (7) Tightness test;
- (8) Cleanness inspection;
- (9) Other tests.

8 Unit/batch inspection

Not applicable.

~~8.1 CCS adopts the unit/batch inspection method for governors. The application for CCS product inspection is permitted only for those governors which have passed the manufacturer's inspection/test and proven to be deliverable.~~

~~8.2 For unit/batch inspection of manufacturer's products obtaining the type approval by CCS~~

~~The factory test program ratified at the time of approval is to be complied with but inclusive of, in general, the following factory test items of governors for different purposes:~~

~~(1) Factory test items of the governor for the main diesel engine:~~

- ~~① Steady state speed regulation measurement and test (for paralleled main engine), which is to be performed in accordance with the requirements of 7.4.1;~~
- ~~② Speed stability bandwidth measurement and test, which are to be performed in accordance with the requirements of 7.4.2;~~
- ~~③ Dynamic characteristic test, which is to be performed in accordance with the requirements of 7.4.3.~~

~~(2) Factory test items of the governor for a single diesel generator set:~~

- ~~① Steady state characteristic test, which is to be performed in accordance with the requirements of 7.5.2;~~
- ~~② Speed stability bandwidth measurement and test, which are to be performed in accordance with the requirements of 7.5.3;~~
- ~~③ Dynamic characteristic test, which is to be performed in accordance with the requirements of 7.5.4.~~

~~(3) Factory test items of governors for diesel generator sets operating in parallel:~~

~~Governors for diesel generator sets operating in parallel may be tested only according to the items in 8.2(2), but the factory is to ensure such governors have similar speed governing characteristic curves as far as possible and adjust the steady state speed regulations to be basically the same. The test related to parallel operation is to be generally conducted by the manufacturer of a complete generator set. The governor manufacturer is to guide the troubleshooting or replacement of the governor which causes the failure of normal parallel operation.~~

~~(4) Factory test of the electronic governor~~

- ~~① The factory test of electronic and electro-hydraulic governors is to generally include such electrical items as insulation resistance measurement and voltage withstanding test;~~
- ~~② The simulation test is to be conducted to verify its compliance with the design requirements.~~

~~(5) Other descriptions~~

~~Taking into consideration the fact that the governor will be subject to final diesel engine speed governing performance test together with the diesel engine in the main engine factory after being matched, the factory test (speed governing performance test) in the governor factory may be generally performed by matching the governor with a particular type of diesel engine or on a special test bench. The mature governor may not be subject to the speed governing performance test after being matched with the diesel engine, but is to be subject to the functional test established by the factory, e.g. test items in 7.8.~~

~~(6) The manufacturer is to finish the above tests individually, issue a complete test report and submit it to the Surveyor for examination; the sampling quantity taken by the Surveyor is to depend on the quantity declared by the factory for inspection. In principle, for batch produced products, at least 2% of the same series of products but not less than 2 sets when the quantity declared by the factory for inspection is more than 50 are to be sampled.~~

Appendix A

(Informative)

Test Record Form

Test record of speed governing characteristic of marine main diesel engine

Table A.1

Diesel engine model		Governor model					Atmospheric pressure/Pa			
Diesel engine number		Governor number					Ambient temperature/°C			
Test date							Relative humidity/%			
Measurement No.	1	2	3	4	5	6	7	8	9	10
Speed/(r/min)										
Power/(r/min)										

Tester:

Measurement record of speed stability bandwidth of marine main diesel engine

Table A.2

Diesel engine model			Governor model		Atmospheric pressure/Pa	
Diesel engine number			Governor number		Ambient temperature/°C	
Test date					Relative humidity/%	
No.	Load percentage/%	Power/ kW	Speed/ r/min	Maximum speed/ r/min	Minimum speed/ r/min	Speed stability bandwidth/ %
1						
2						
3						
4						
5						
6						

Tester:

Test record of dynamic characteristic of speed governing system for marine main diesel engine

Table A.3

Diesel engine model		Governor model		Atmospheric pressure/Pa							
Diesel engine number		Governor number		Ambient temperature/°C							
Test date		Relative humidity/%									
Test item	Number of measurements	Before instant unloading		Maximum transient speed/r/min	After speed recovery		Calculation result			Recovery number	Remarks
		Power/kW	Speed/r/min		Power/kW	Speed/r/min	Transient speed regulation δ_a /%	Steady state speed regulation δ_{st} /%	Speed recovery time τ /s		
Instant unloading from 100% to 0	1										
	2										
	3										
	Average										

Teste:

Test record of speed governing characteristic of marine diesel generator set

Table A.4

Diesel engine model		Generator model			Governor model		Atmospheric pressure/Pa	
Diesel engine number		Generator number			Governor number		Ambient temperature/°C	
Test date					Relative humidity/%			
No.	Load percentage/ %	Power/ kW	Speed/ r/min	Frequency/ Hz	Power factor cosφ	Line voltage/V	Line current/A	Remarks
1								
2								
3								
4								
5								
6								
7								
8								
9								

Teste:

Measurement record of speed stability bandwidth of marine diesel generator

Table A.5

Diesel engine model			Generator model		Governor model	
Diesel engine number			Generator number		Governor number	
Atmospheric pressure/Pa			Ambient temperature/°C		Relative humidity/%	
No.	Load percentage/ %	Power/ kW	Speed/ r/min	Maximum speed/ r/min	Minimum speed/ r/min	Speed stability bandwidth/ %
1						
2						
3						
4						
5						
6						

Tester:

Record of remote speed regulation of marine diesel generator set

		Governor model		Servo motor model	
		Governor number		Reduction gearbox model	
				Speed ratio	
y/Hz		Speed/(r/min)	Required time/s	Speed regulation/r/s	Relative speed regulation/(%/s)

Test record of difference of load sharing at parallel operation for sets

DD-MM-YY

No.	Total load change mode	Master power grid					Total power factor cos
		Power/ kW	Frequency/ Hz	Line voltage/ V	Line current/ A		
1	75%						
2	100%						
3	75%						
4	50%						
5	20%						
6	50%						
7	75%						

Test record of load sharing stability at parallel operation for sets

DD-MM-YY

No.	Total load change mode	Master power grid				
		Power/ kW	Frequency/ Hz	Line voltage/ V	Line current/ A	Total power factor cos
1	20%					
2	50%					
3	75%					
4	90%					
5	90%					
6	90%					
7	90%					
8	90%					